



2000 I-30 E
Greenville, TX 75402

Friday, January 7, 2022

Office of Hopkins County Judge
PO Box 288
Sulphur Springs TX 75483

Farmers Electric Cooperative Member: LINDA HUDSON
Service Order Number: 2021123348

Greetings:

Farmers Electric Cooperative, Inc. is requesting permission to construct electrical power distribution facilities which will cross County Road 3355 which is located 40' W OF CR 3355 AND 1050' E OF CR 3355/3353 INTERSECT in Hopkins County, Texas.

Site location map and construction sketches are enclosed. The construction sketch details the proposed work. All road crossings will have a minimum vertical clearance of 22 feet.

If you have any questions, please contact me at any time.

Sincerely,

Colton McDonald
Project Coordinator
cmdonald@farmerselectric.coop
Phone 903-513-9024

Submitted by Psalm Harper
pharper@farmerselectric.coop
Field Engineering Coordinator


Enclosures

County Approval Section:

Approved: *RM* Denied: _____

Authorized Signature: *Wade Bartley* Date: 1-10-2022
for Wade Bartley

7.2KV

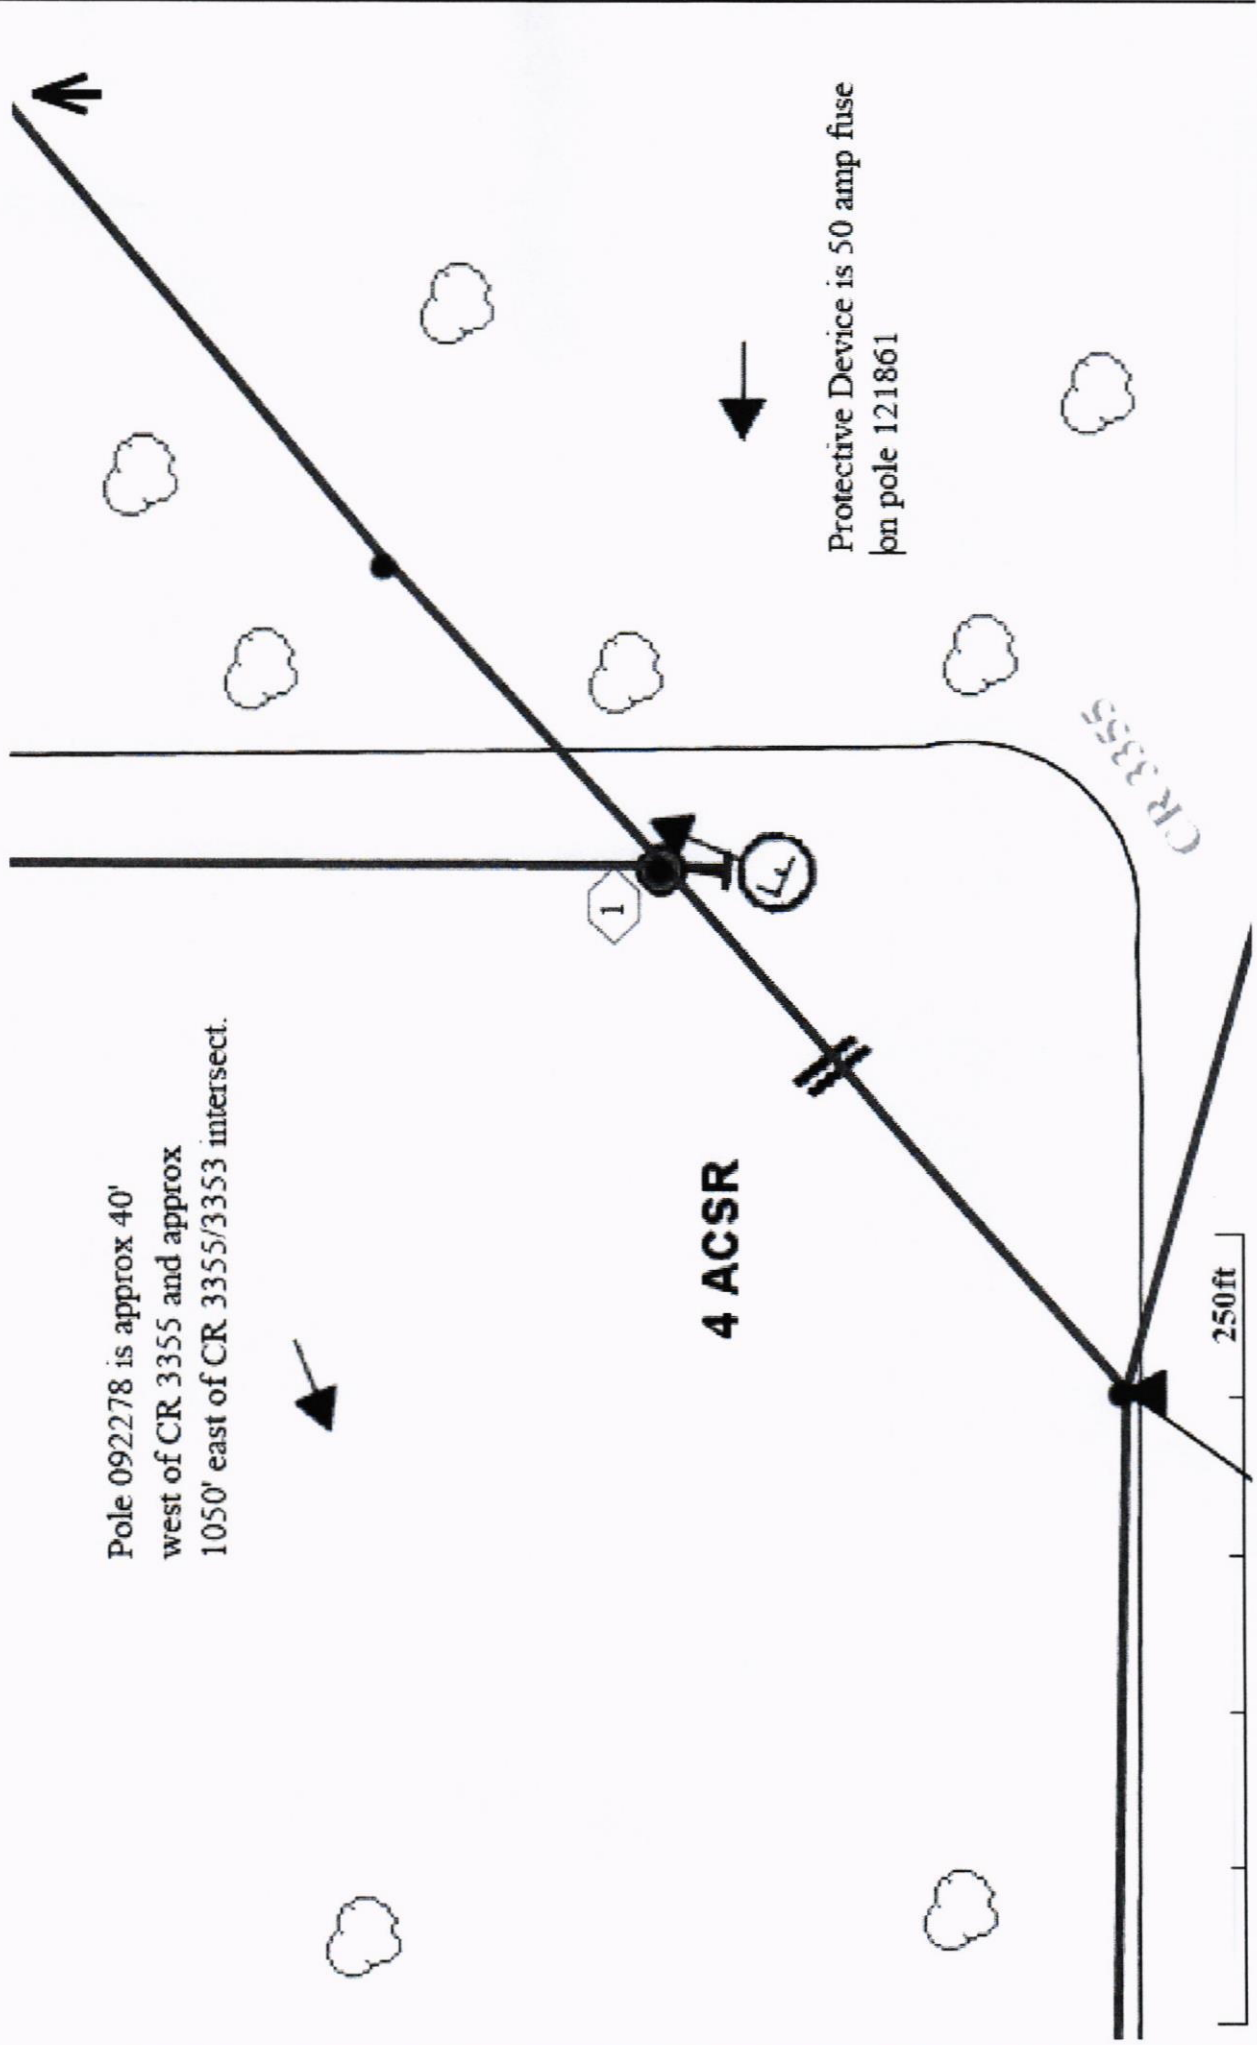

Pole 092278 is approx 40' west of CR 3355 and approx 1050' east of CR 3355/3353 intersect.

4 ACSR

Protective Device is 50 amp fuse on pole 121861

CR 3355

250ft

CROSSING CR 3355 AT P092278
40' W OF CR
3355 AND 1050' E OF CR
3355/3353 INTERSECT

234



MARTIN ALLAIN

ity Road 3355